

# DYNAMIC STABILITY ENHANCEMENT USING PSS AND UPFC

Nagasubbaiah.V<sup>1</sup>, Rama Subbanna.S<sup>2</sup>, Venkateswar Reddy<sup>3</sup>

<sup>1</sup>M.Tech, <sup>2</sup>Asst.Prof, <sup>3</sup>HOD

Chaitanya Bharathi Institute of Technology

Proddatur, Vidyanagar, YSR Kadapa

[sankar.neeru@gmail.com](mailto:sankar.neeru@gmail.com)

**Abstract—** In this paper, a new PSO based PSS is proposed for the UPFC to damp power system low frequency oscillations. In order to damp the power systems oscillations effectively, Power system stabilizer is proposed for UPFC. The parameters of PSS are tuned using PSO algorithm. The effectiveness of the proposed control strategy is evaluated under different fault conditions in comparison with the GA based PSS to demonstrate its robust performance through time simulation studies and specific performance indices.

**Index Terms—** UPFC, GA, PSO, FACTS devices, Power System Stability.

## I. INTRODUCTION

In the recent years, the fast progress in the field of power electronics had opened new opportunities for the application of the FACTS devices as one of the most effective ways to improve power system operation controllability and power transfer limits [1–2]. The Unified Power Flow Controller (UPFC) is regarded as one of the most versatile devices in the FACTS device family [3-4] which has the ability to control power flow in the transmission line, improve the transient stability, mitigate system oscillation and provide voltage support. It performs this through the control of the in-phase voltage, quadrature voltage and shunts compensation due to its main control strategy [1,4]. Investigations on the UPFC main control effects show that the UPFC can improve system transient stability and enhance the system transfer limit as well. The application of the UPFC to the modern power system can therefore lead to the more flexible, secure and economic operation [10]. When the UPFC is applied to the interconnected power systems, it can also provide significant damping effect on tie line power oscillation through its supplementary control. The modern power system tends to be interconnected to yield the most economic benefits. However, low frequency oscillation will occur on the heavily loaded tie lines especially after a large or small disturbances. Sometimes the Power System Stabilizer (PSS) installed on a specific generator cannot provide effective damping for that kind of oscillations. In [5, 6], it is shown that the addition of a conventional supplementary controller to the UPFC is an

effective solution to the problem. However, an industrial process, such as a power system, contains different kinds of uncertainties due to continuous load changes or parameters drift due to power systems highly nonlinear and stochastic operating nature. As a result, a fixed parameter controller based on the classical control theory such as PI or lead-lag controller [5-8] is not certainly suitable for the UPFC damping control methods. Thus, it is required that a flexible controller be developed. Some authors suggested neural networks method [9] and robust control methodologies [10-12] to cope with system uncertainties to enhance the system damping performance using the UPFC. However, the parameters adjustments of these controllers need some trial and error. Also, although using the robust control methods, the uncertainties are directly introduced to the synthesis, but due to the large model order of power systems the order resulting controller will be very large in general, which is not feasible because of the computational economical difficulties in implementing.

Recently, applications of the Fuzzy Logic (FL) theory to the engineering issues have drawn tremendous attention from researchers [13-14]. The fuzzy controller has a number of distinguish advantages over the conventional one. It is not so sensitive to the variation of system structure, parameters and operation points and can be easily implemented in a large-scale nonlinear system. The most attractive feature is its capability of incorporating human knowledge to the controller with ease. This approach provides the FL systems better functionality, performance, adaptability, reliability and robustness. The most dynamic area of fuzzy systems research in the power systems has been the stability enhancement and assessment. Some authors used FL-based damping control strategy for TCSC, UPFC and SVC in a multi-machine power system [15, 16]. The damping control strategy employs non-optimal FL controllers that is why the system's response settling time is unbearable. Dash et al. presented a fuzzy damping control system for series connected FACTS devices, e.g. TCSC, UPFC and TCPST to enhance power system stability[17]. The FL-based damping controller may exhibit lack of robustness due to its simplicity and the system's response for a wide incursion in the operating condition is anticipated to deteriorate. Limyingcharone et al. [18] applied fuzzy logic based UPFC for the transient stability

improvement. Khon and Lo [19] used a fuzzy damping controller designed by micro Genetic Algorithm (GA) for TCSC and UPFC to improve powers system low frequency oscillations. The proposed method may have not enough robustness due to its simplicity against the different kinds of uncertainties and disturbances. Mak et al. [20] applied a GA-based Power system stabilizer (PSS) and UPFC combination is used to enhance power. system damping. The GA based PSS and UPFC damping the oscillations but takes more settling time. In order to overcome the above drawbacks, PSO based PSS and UPFC is used to damp the oscillations effectively. In this paper the parameters of PSS are obtained using PSO optimized algorithm.

## II. POWER SYSTEM MODEL WITH UPFC

Fig.1 shows a SMIB system equipped with a UPFC. The UPFC consists of an Excitation Transformer, a Boosting Transformer, two three-phase GTO based Voltage Source Converters (VSCs), and a DC link capacitors. The four input control signals to the UPFC are  $m_E$ ,  $m_B$ ,  $\delta_E$ , and  $\delta_B$ . Where,  $m_E$  is the excitation amplitude modulation ratio,  $m_B$  is the boosting amplitude modulation ratio,  $\delta_E$  is the excitation phase angle and  $\delta_B$  is the boosting phase angle. By applying Park's transformation and neglecting the resistance and transients of the ET and BT transformers, the UPFC can be modeled as [22-23]:

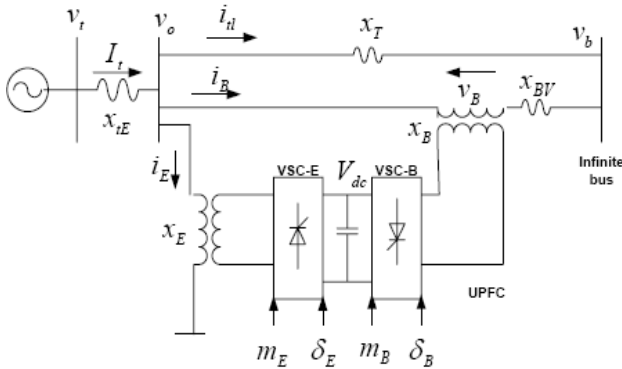


Fig.1. SMIB power system equipped with UPFC

$$\begin{bmatrix} V_{Etd} \\ V_{Eiq} \end{bmatrix} = \begin{bmatrix} 0 & -X_E \\ X_E & 0 \end{bmatrix} \begin{bmatrix} i_{Ed} \\ i_{Eq} \end{bmatrix} + \begin{bmatrix} \frac{m_E \cos(\delta_E) V_{dc}}{2} \\ \frac{m_E \sin(\delta_E) V_{dc}}{2} \end{bmatrix} \quad (1)$$

$$\begin{bmatrix} V_{Btd} \\ V_{Biq} \end{bmatrix} = \begin{bmatrix} 0 & -X_B \\ X_B & 0 \end{bmatrix} \begin{bmatrix} i_{Bd} \\ i_{Bq} \end{bmatrix} + \begin{bmatrix} \frac{m_B \cos(\delta_B) V_{dc}}{2} \\ \frac{m_B \sin(\delta_B) V_{dc}}{2} \end{bmatrix} \quad (2)$$

$$\frac{dV_{dc}}{dt} = \frac{3m_E}{4C_{dc}} \begin{bmatrix} \cos \delta_E & \sin \delta_E \\ \sin \delta_E & \cos \delta_E \end{bmatrix} \begin{bmatrix} i_{Ed} \\ i_{Eq} \end{bmatrix} + \frac{3m_B}{4C_{dc}} \begin{bmatrix} \cos \delta_B & \sin \delta_B \\ \sin \delta_B & \cos \delta_B \end{bmatrix} \begin{bmatrix} i_{Bd} \\ i_{Bq} \end{bmatrix} \quad (3)$$

Where  $V_{Et}$ ,  $i_E$ ,  $V_{Bt}$ , and  $i_B$  are the excitation voltage, excitation current, boosting voltage, and boosting current, respectively;  $C_{dc}$  and  $V_{dc}$  are the DC link capacitance and voltage, respectively. The nonlinear model of the SMIB system as shown in Fig. 1 is described by:

$$\omega^* = (P_m - P_e - D\Delta\omega) / M \quad (4)$$

$$\delta^* = \omega_o (\omega - 1) \quad (5)$$

$$E_q^* = (-E_q + E_{fd}) / T'_{do} \quad (6)$$

$$E_{fd}^* = (-E_{fd} + K_a (V_{ref} - V_t)) / T_a \quad (7)$$

Where

$$P_e = V_{td} I_{td} + V_{tq} I_{tq}; \quad E_q = E'_{qe} + (X_d - X'_d) I_{td}$$

$$V_t = V_{td} + jV_{tq}; \quad V_{td} = X_q I_{tq}; \quad V_{tq} = E'_q - X'_d I_{td}$$

## III. PSO BASED POWER SYSTEM STABILIZER




Fig.2. Block diagram of PSS controller.

The structure of the PSS based is shown in Fig.2. It consists of gain, signal washout and phase compensator blocks. The parameters of the PSS are obtained using Partial swarm optimization method.

The parameters of PSS are gain, Time constants for lead blocks. These parameters are obtained using an one of the best optimized algorithm PSO. The performance of the proposed PSOPSS controller are shown in Figs.9 to 12 for different fault conditions. The flow chart used for this optimization is shown in Fig.3

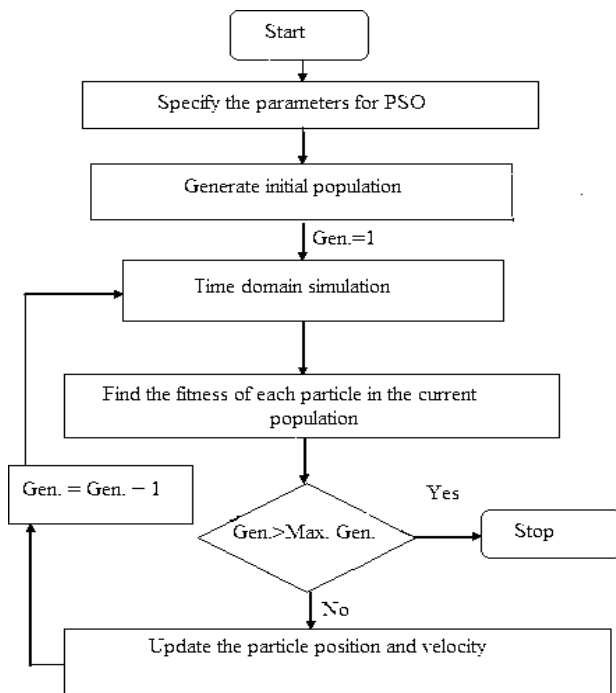


Fig.3. PSO algorithm Flowchart

#### IV. SIMULATION RESULTS

The simulation diagrams are shown in Fig.4. The performance of GA based PSS and UPFC is shown in Fig.5 to Fig.8 and performance of PSO based PSS and UPFC is shown in Fig.9 to Fig.12. Fig.5 shows change in delta with respect to time with single line to ground fault with GA based PSS and UPFC. Fig.6 shows power system stabilizer output with single to ground fault with GA based PSS and UPFC. Fig.7 shows change in delta with respect to time with double line to ground fault with GA based PSS and UPFC. Fig.8 shows power system stabilizer output with double line to ground fault with GA based PSS and UPFC. Fig.9 shows change in delta with

respect to time with single line to ground fault with PSO based PSS and UPFC. Fig.10 shows power system stabilizer output with single to ground fault with PSO based PSS and UPFC. Fig.11 shows change in delta with respect to time with double line to ground fault with PSO based PSS and UPFC. Fig.12 shows power system stabilizer output with double line to ground fault with GA based PSS and UPFC.

It can be seen that the proposed PSOPSS controller is very effective, achieve good robust performance, compared to GA based PSS and UPFC have the best ability to reduce power system low frequency oscillations.

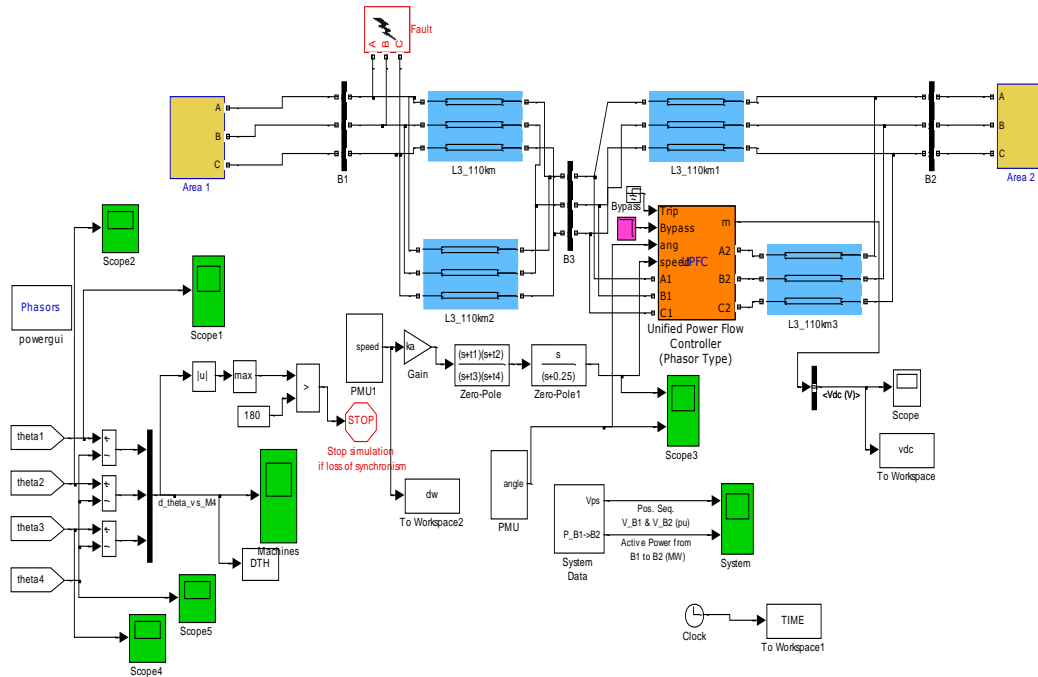


Fig.4. Simulation diagram for both GA based PSS and PSO based PSS with UPFC.

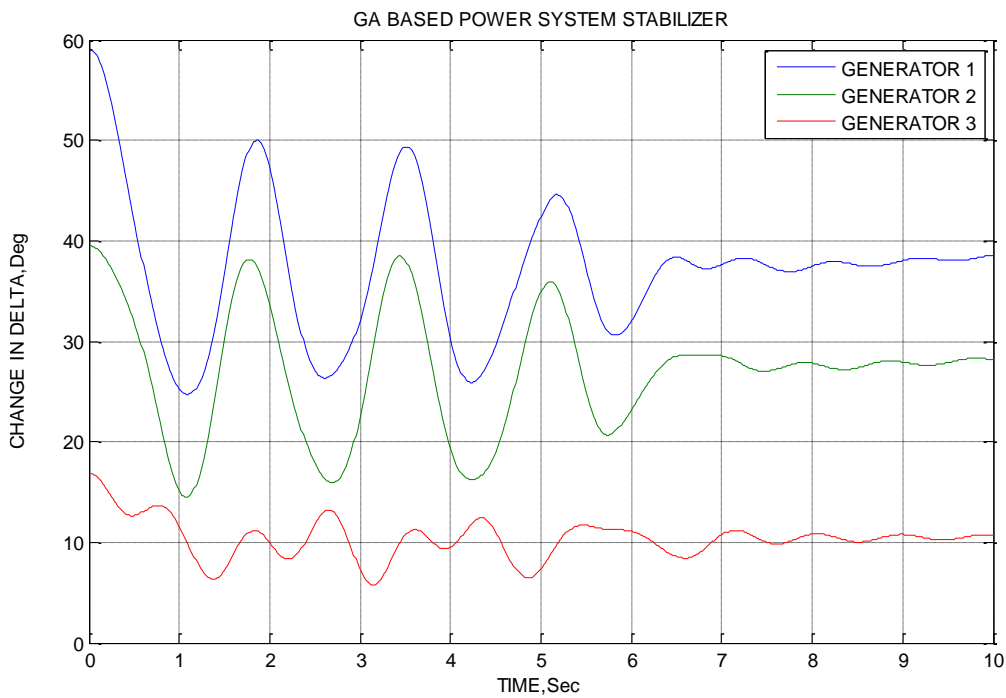


Fig.5. Power system response for single line to ground fault (Line a to ground) using GA based PSS and UPFC.

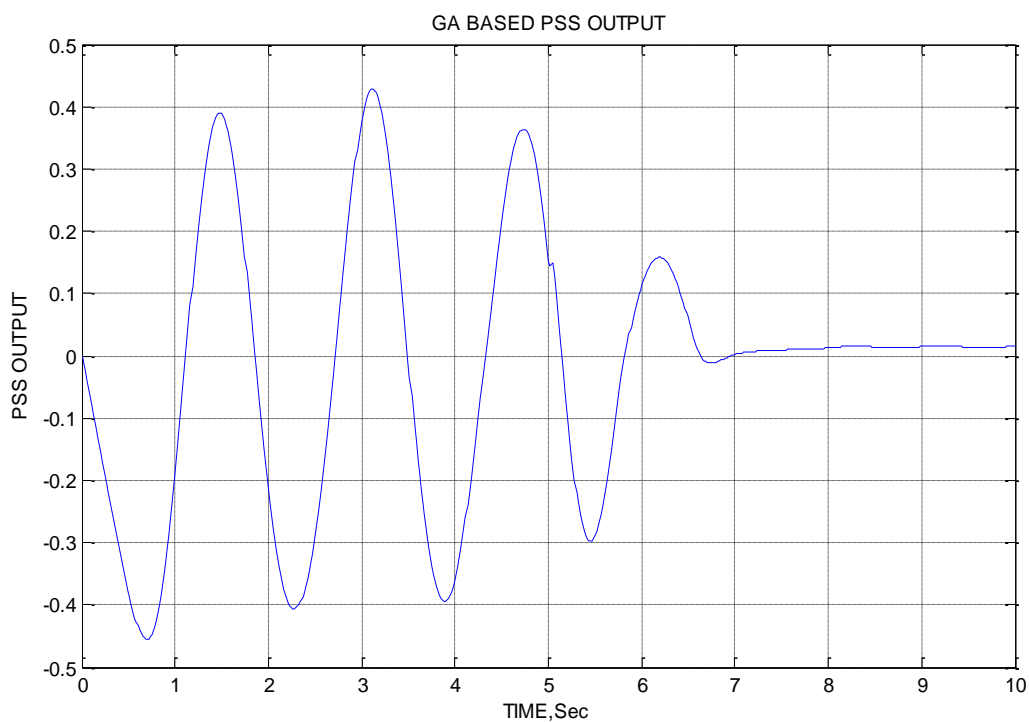


Fig.6. Power system stabilizer output for single line to ground fault (Line a to ground) using GA based PSS and UPFC.

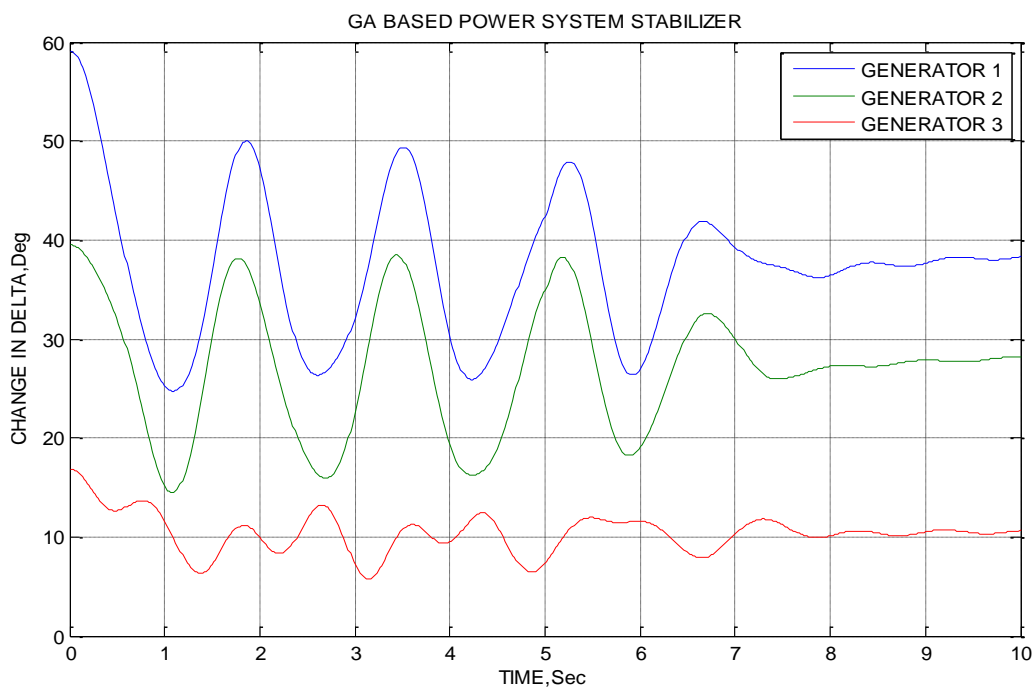


Fig.7. Power system response for double line to ground fault (Lines a,b to ground) using GA based PSS and UPFC.

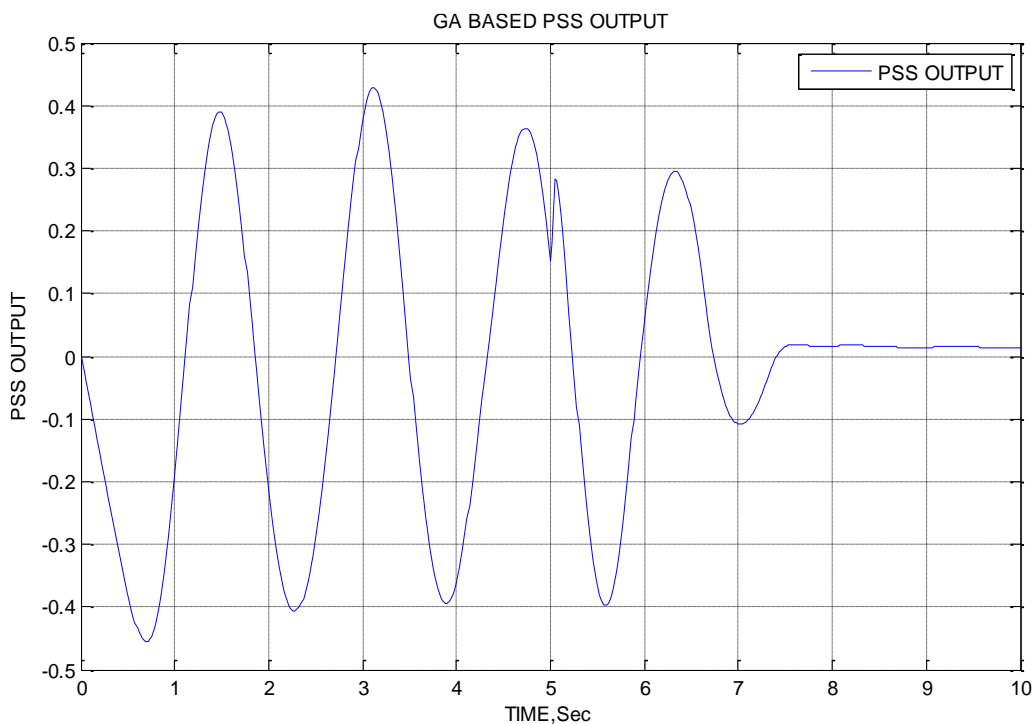


Fig.8. Power system stabilizer output for double line to ground fault (Line a,b to ground) using GA based PSS and UPFC.

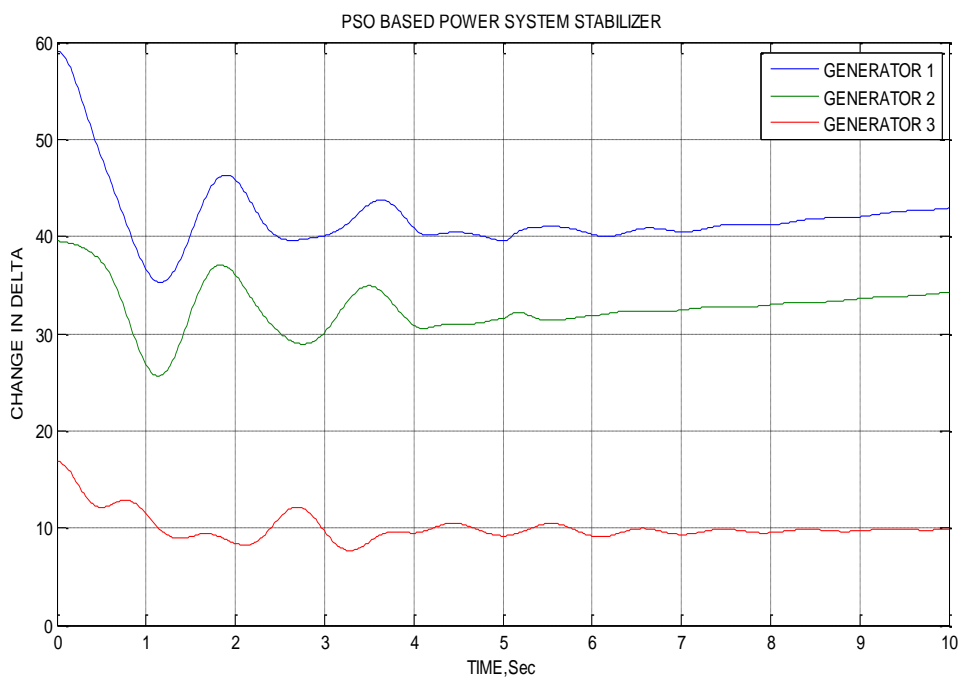


Fig.9. Power system response for single line to ground fault (Lines a to ground) using PSO based PSS and UPFC.

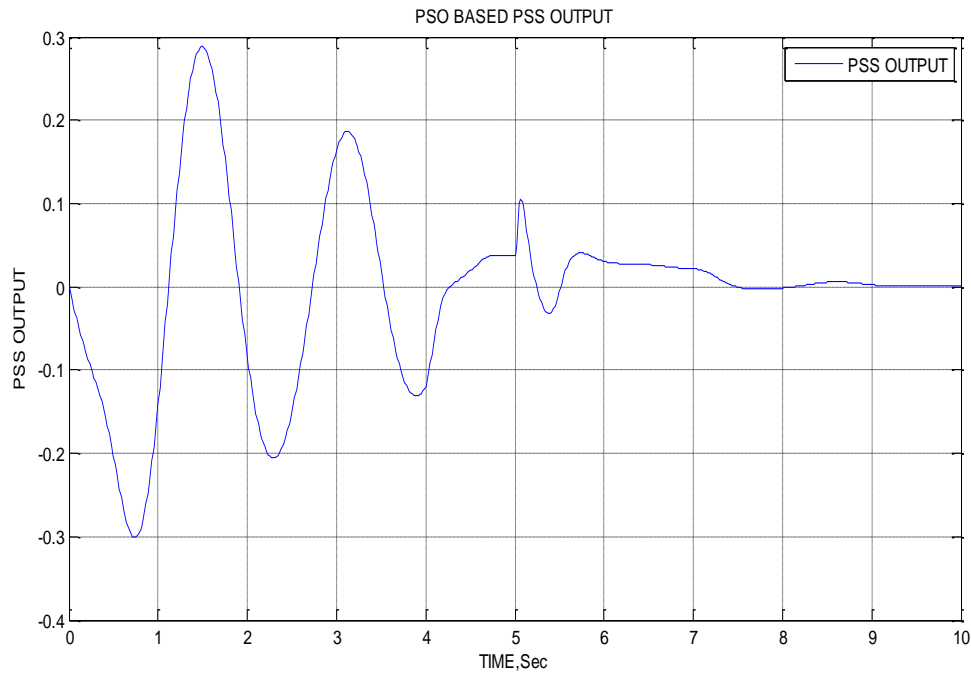


Fig.10. Power system stabilizer output for single line to ground fault (Line a to ground) using PSO based PSS and UPFC.

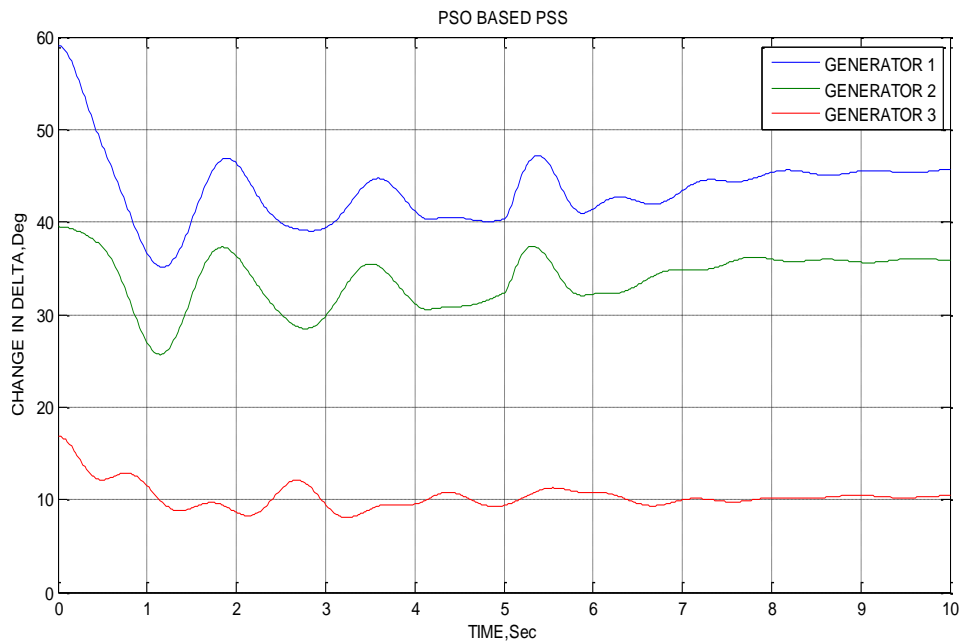


Fig.11. Power system response for double line to ground fault (Lines a,b to ground) using PSO based PSS and UPFC.

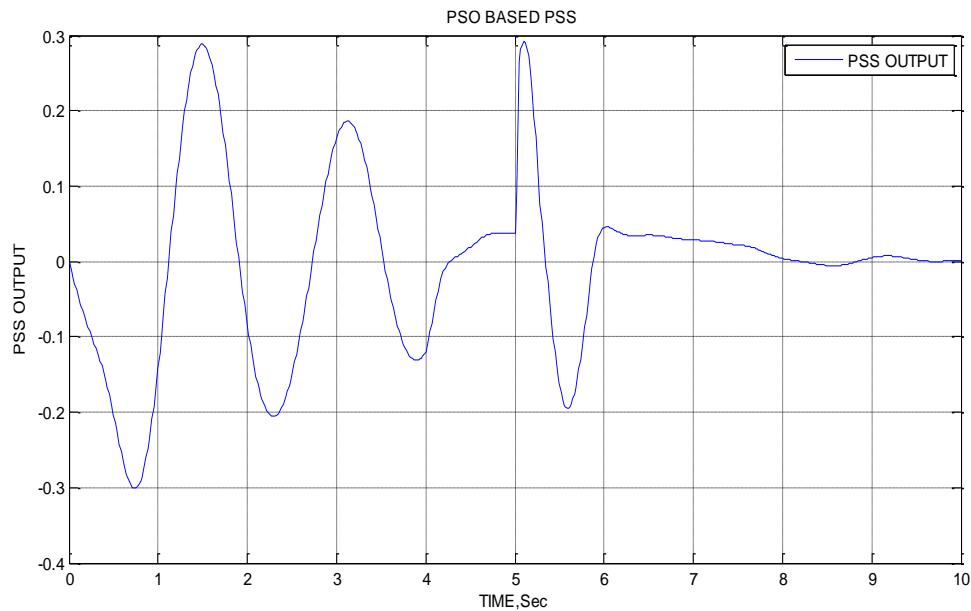


Fig.12. Power system stabilizer output for single line to ground fault (Line a to ground) using PSO based PSS and UPFC

## V.CONCLUSIONS

In this paper, a new PSOPSS stabilizer is proposed for the UPFC for damping power system low frequency oscillations. The construction and implementation of proposed controller is fairly easy and economical, which can be useful in real world power system. The proposed controller has been tested on a 3 machine 9 bus power system in comparison with the GA based PSS controllers under different fault conditions.

## REFERENCES

- [1] Y.H. Song, A.T. Johns, Flexible AC transmission systems (FACTS), UK: IEE Press; 1999.
- [2] N.G. Hingorani, L. Gyugyi, Understanding FACTS: Concepts and technology of flexible AC transmission systems, Wiley-IEEE Press; 1999.
- [3] L. Gyugyi, Unified power-flow control concept for flexible ac transmission systems, *IEE Proc. On Generation, Transmission and Distribution*, Vol. 139 No. 4, 1992, pp. 323-31.
- [4] IEEE Power Engineering Society and CIGRE, FACTS overview, *IEEE Publication* No. 95 TP 108, 1995.
- [5] N. Tambey, M.L. Kothari, Damping of power system oscillations with unified power flow controller (UPFC), *IEE Proc. On Generation, Transmission and Distribution*, Vol. 150, No. 2, 2003; pp.129-40.
- [6] M.M. Farsangi, Y.H Song, K.Y. Lee, Choice of FACTS device control inputs for damping inter-area oscillations, *IEEE Trans. On Power Systems*, Vol. 19, No. 2, 2004, pp. 1135-43.
- [7] K.R. Padiyar, H.V. Saikumar., Coordinated design and performance evaluation of UPFC supplementary modulation controllers, *Electrical Power and Energy System.*, Vol. 27, 2005, pp. 101-111.
- [8] P.C Stefanov., A.M. Stankovic, Modeling of UPFC operation under unbalanced conditions with dynamic phasors, *IEEE Trans. On Power Systems*, Vol. 17, No. 2, : 2002; 395-403.
- [9] P.K. Dash, S. Mishra, G. Panda, A radial basis function neural network controller for UPFC, *EEE Trans. On Power Systems*, Vol. 15, No. 4, 2000, pp. 1293-9.
- [10] M. Vilathgamuwa, X. Zhu, S.S. Choi, A robust control method to improve the performance of a unified power flow controller, *Electric Power Systems Research*, Vol. 55, 2000, pp.103-11.
- [11] B C. Pal, Robust damping of interarea oscillations with unified power flow controller, *IEE Proc. On Generation, Transmission and Distribution*, Vol. 149, No. 6, 2002, pp. 733-8.



- [12] J.-C. Seo, S.-I. Moon, J.-K. Park, J.-W. Choe, Design of a robust UPFC controller for enhancing the small signal stability in the multi-machine power systems, *Proc. of the IEEE PES Winter Meeting*, Vol. 3, 28 January–1 February, 2001, pp. 1197-202.
- [13] L.-X. Wang, A course in fuzzy systems and control, NJ: Prentice Hall; 1997.
- [14] M.E. El-Hawary, Electric power applications of fuzzy systems, New York: IEEE Press; 1998.
- [15] K.L Lo., Y.J. Lin, Strategy for the control of multiple series compensators in the enhancement of interconnected power system stability, *IEE Proc. On Generation, Transmission and Distribution*, Vol. 146, No. 2, 1999, pp. 149-158.
- [16] A. Kazemi, M. Vakili Sohrforouzani, Power system damping controlled facts devices, *Electrical Power and Energy Systems*, Vol. 28, 2006, pp. 349-357.
- [17] P.K. Dash, S. Mishra, G. Panda, Damping multimodal power system oscillation using hybrid fuzzy controller for series connected FACTS devices, *IEEE Trans. on Power Systems*, Vol. 15, No. 4, 2000, pp. 1360-1366.
- [18] S. Limyingcharone, U.D. Annakkage, N.C. Pahalawaththa, Fuzzy logic based unified power flow controllers for transient stability improvement, *IEE Proc. On Generation, Transmission and Distribution*, Vol. 145, No.3, 1998, pp. 225-232.
- [19] L. Khon, K. L. Lo., Hybrid micro-GA based FLCs for TCSC and UPFC in a multi machine environment, *Electric Power Systems Research*, Vol. 76, 2006, pp. 832-843
- [20] T.K. Mok, H. Liu, Y. Ni, F. F. Wu, R. Hui, Tuning the fuzzy damping controller for UPFC through genetic algorithm with comparison to the gradient descent training, *Electric Power and Energy Systems*, Vol. 27, 2005, pp. 275-283.
- [21] H. Shayeghi, A. Jalili, A Hybrid Fuzzy AGC in a competitive electricity environment, *Int. Journal of Electrical Systems Science and Engineering*, Vol. 1, No. 3, 2008, pp. 184-195.
- [22] A. Nabavi-Niaki, M.R. Iravani, Steady-state and dynamic models of unified power flow controller (UPFC) for power system studies, *IEEE Trans. on Power Systems*, Vol. 11, No. 4, 1996, pp. 1937-43.
- [23] H. F. Wang, Damping function of unified power flow controller, *IEE Proc. On Generation, Transmission and Distribution*, 1999, Vol. 146, No. 1, 1999, 81-7.